


**PLAN**

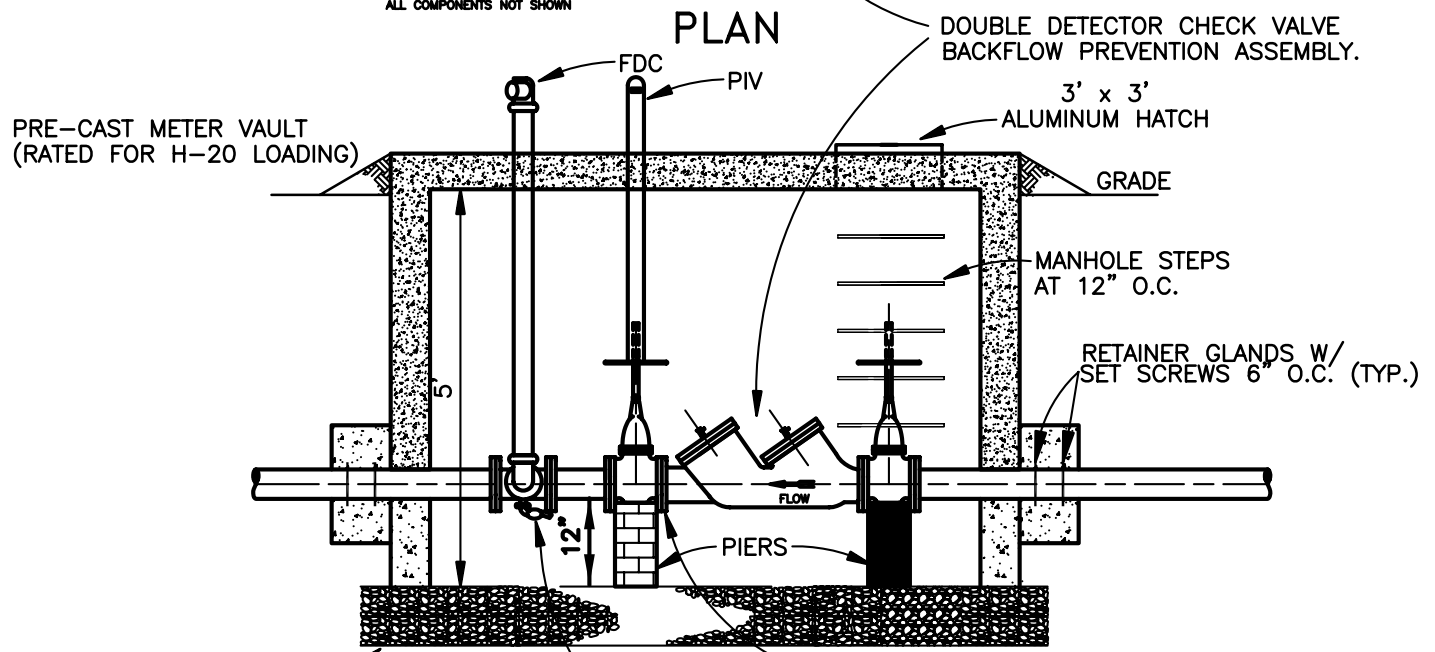

**SECTION**

**NOTES:**

1. BOXES EXCEEDING 5' IN DEPTH MUST BE APPROVED BY THE CITY.
2. WHEN METER BOX CANNOT BE LOCATED ENTIRELY ON R/W, A PERMANENT EASEMENT SHALL BE OBTAINED TO PREVENT FENCES OR OTHER OBSTRUCTION FROM BEING ERRECTED AROUND THE METER BOX.
3. COVER OPENING & STEPS TO BE PLACED NEAREST THE METER REGISTER.
4. THESE BOXES ARE NOT TO BE INSTALLED IN TRAFFIC AREAS WITHOUT PRIOR PERMISSION FROM THE CITY.
5. ALL VALVES AND FITTINGS INSIDE THE VAULT SHALL BE FLANGED.
6. REDUCED PRESSURE DETECTOR ASSEMBLY REQUIRED WHEN THE DANGER FROM BACKFLOW PRESENTS A HEALTH HAZARD.

**CITY OF COVINGTON  
CROSS-CONNECTION  
CONTROL PROGRAM**

**DOUBLE  
DETECTOR CHECK  
VALVE IN VAULT**  
CONSTRUCTION STANDARD

ORIGINAL	FEB. 1996
REVISED	APR. 2006

APPROVED:

STANDARD  
NO.  
**06**